


Drawing File: C:\Users\chudson\appdata\local\temp\AcPublish_16260\E1312.dwg
Plotted by: chudson
Plotted Date: Jun 24, 2022 -- 10:17am

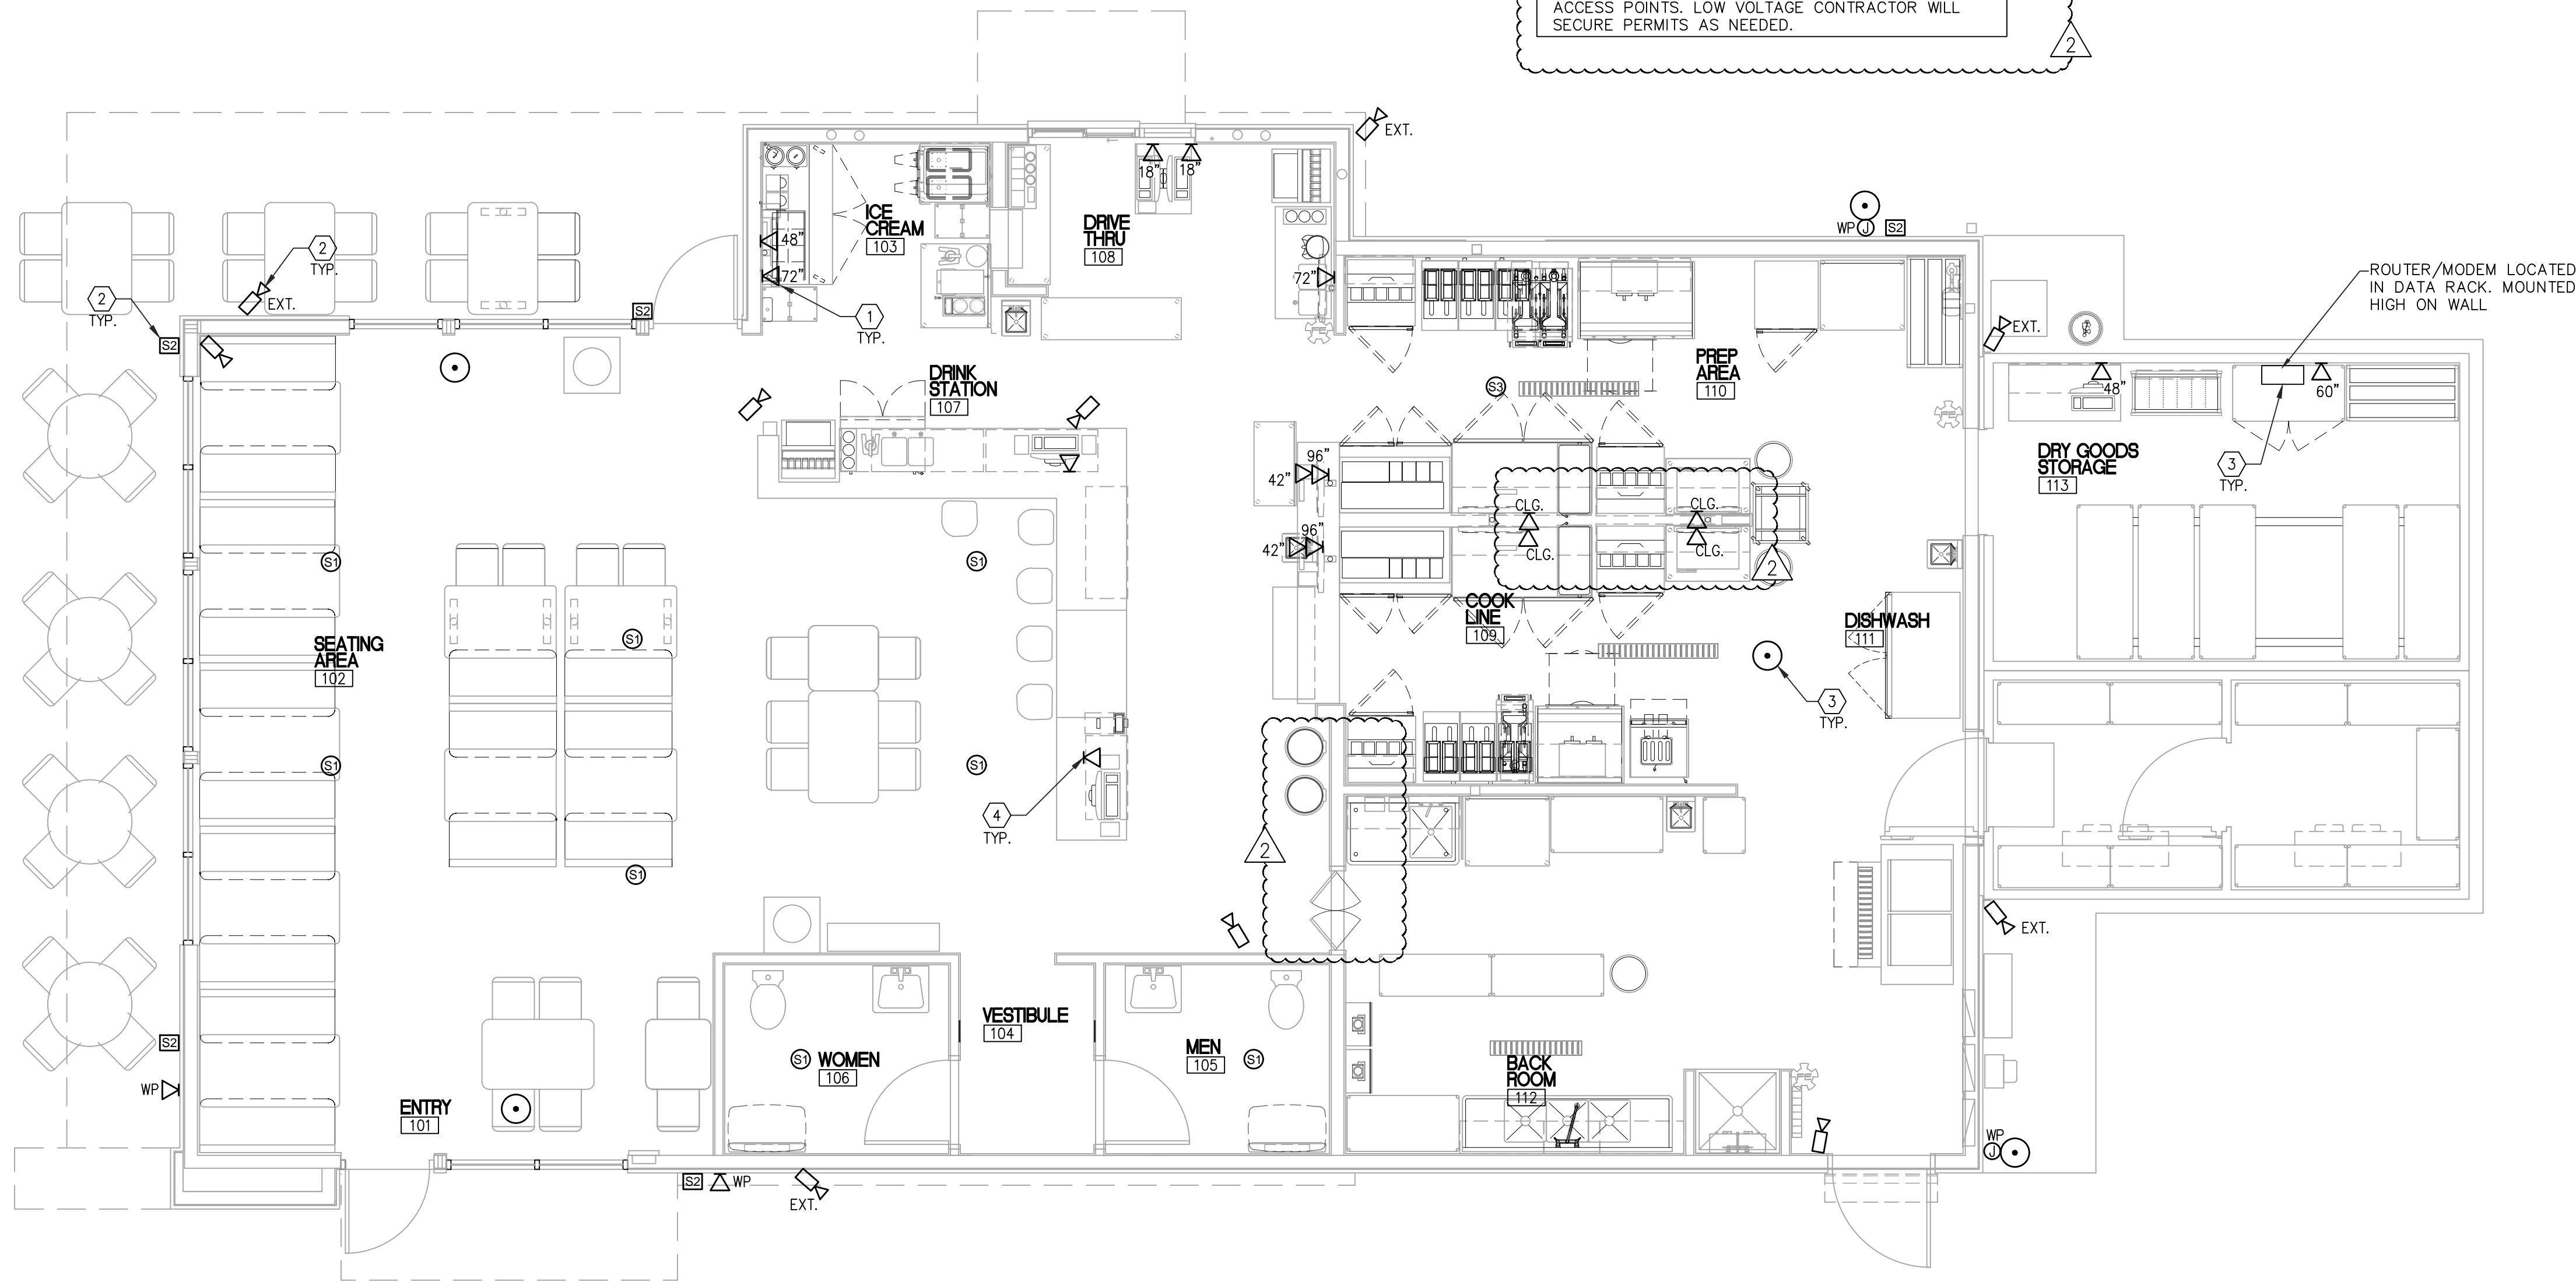

1 **ELECTRICAL LOW VOLTAGE PLAN**
E131 SCALE: 1/4" = 1'-0"

CONSTRUCTION NOTES

- 1 EC SHALL PROVIDE 2-GANG BOXES, EMPTY CONDUIT WITH PULL STRING UP TO THE CEILING FOR KITCHEN MONITORS, PRINTERS AND BUMPBAR. COORDINATE ROUGH-IN HEIGHTS AND EXACT REQUIREMENTS WITH LL/TENANT AND LL'S/TENANT'S VENDOR PRIOR TO ROUGH-IN.
- 2 EC SHALL PROVIDE AND INSTALL STUB THRU CONDUIT FROM EXTERIOR WALL FOR EXTERIOR SPEAKER AND SECURITY CAMERAS. VERIFY FINAL LOCATION AND REQUIREMENTS WITH LL/TENANT AND LL'S/TENANT'S VENDOR PRIOR TO ROUGH-IN.
- 3 EC SHALL PROVIDE AND INSTALL CONDUITS WITH PULL WIRE UP TO 6" ABOVE THE CEILING FROM MODEM LOCATION TO RUN LOW VOLTAGE CABLING TO POS AND ACCESS POINTS. VERIFY WITH IT CONTRACTOR FOR REQUIRED CONDUIT SIZE AND QUANTITY.
- 4 EC SHALL PROVIDE AND INSTALL STUB UP CONDUIT FROM NEAREST FULL HEIGHT WALL TO LOW HEIGHT WALL AT FRONT POS LOCATIONS. VERIFY FINAL LOCATION AND REQUIREMENTS WITH LL/TENANT AND LL'S/TENANT'S VENDOR PRIOR TO ROUGH-IN.

GENERAL NOTES

1. ELECTRICAL CONTRACTOR TO CONFIRM / COORDINATE LOCATIONS OF SECURITY CAMERAS, SPEAKERS AND WIRELESS ACCESS POINTS WITH LL/TENANT AND LL'S/TENANT'S VENDOR.
2. POS STATIONS AND I.T. EQUIPMENT INSTALLED BY LL'S/TENANT'S VENDOR- EC TO PROVIDE POWER/DATA OUTLETS AS REQUIRED.
3. EC SHALL PROVIDE REQUIRED J-BOX AND CONDUITS WITH PULL WIRE FOR LOW VOLTAGE CABLES AS REQUIRED FOR POS, KITCHEN MONITORS, SECURITY AND MUSIC SYSTEMS. COORDINATE EXACT REQUIREMENTS WITH LL'S/TENANT'S VENDOR..

LOW VOLTAGE SYSTEM LEGEND

SYMBOL	DESCRIPTION
ⓂP	WEATHER PROOF LOW VOLTAGE JUNCTION BOX
Ⓢ	CEILING FLUSH MOUNT INTERIOR SPEAKER
Ⓢ	DRIVE THRU COOKLINE SPEAKER
Ⓢ	MUSIC SPEAKERS (EXTERIOR WALL MOUNTED)
□	ROUTER/MODEM LOCATION
○	ACCESS POINT
📷	SECURITY CAMERA
EXT. 📷	EXTERIOR SECURITY CAMERA
⚡	DATA WALL OUTLET - RUN 3/4" EMT TO ACCESSIBLE POINT ABOVE CEILING. PROVIDE PULL WIRE.

THIS IS GENERIC LAYOUT. VERIFY EXACT LOCATION AND REQUIREMENTS FOR SECURITY AND IT DEVICES WITH LL'S/TENANT'S VENDOR. PRIOR TO ROUGH-INS.

LOW VOLTAGE WORK WILL BE PROVIDED BY HWY55 NATIONAL LOW VOLTAGE CONTRACTOR. LOW VOLTAGE CONTRACTOR PROVIDE AND INSTALL LOW VOLTAGE WIRING, CABLES, SPEAKERS, CAMERAS, POS AND ACCESS POINTS. LOW VOLTAGE CONTRACTOR WILL SECURE PERMITS AS NEEDED.

LMHT Project No. 21318

THIS DRAWING IS THE PROPERTY OF THE ARCHITECT AND MAY NOT BE REPRODUCED OR USED WITHOUT THE WRITTEN PERMISSION.

INRD national restaurant designers
ARCHITECTS & ENGINEERS
7208 ACC Blvd., second floor, Raleigh, NC 27617
ph: 919 544 0087 fax: 919 544 9399

06.24.2022

SEAL
049994

ENGINEER
J. LUMAS P.I.T.E.L.

LMHT ENGINEER LICENSE
NUMBER - C-1369

PROJECT: **HIGHWAY 55**
3.0 PROTOTYPE
1424 CURTIS BRIDGE ROAD
WILKESBORO, NC 28697

DRAWING: ELECTRICAL LOW VOLTAGE PLAN

Revisions	
THRU ADDENDUM 01/20/2022	"A"
EQUIP. UPDATE - 06.24.2022	
PROJECT DATE 01/07/2022	
Drawn By JP	
Checked By JP	
Sheet No.	E131